


**PLAN VIEW**


**NOTES:**

1. STATION REQUIRES 120 VOLT, 5 AMP DEDICATED CIRCUIT (PROVIDED BY OTHERS).
2. ONE (7/8") DIA. HOLE ON TOP OF STATION FOR COMMUNICATION CABLES AND ONE (7/8") CONDUIT FOR ELECTRICAL CONNECTION.
3. STATION IS FLOOR MOUNTED.
4. CONTROL PANEL IS HEIGHT IS APPROXIMATELY 56" TO CENTER. STATION IS NOT SUBJECT TO ADA REQUIREMENTS SINCE IT IS NOT USED BY THE PUBLIC.
5. ROUGH OPENING IS 20"x29"x63".
6. STATION WEIGHT IS 227 LBS.

ETHERNET CONNECTION TO AN ACTIVE JACK (INSIDE UNIT) ON THE SAME IT NETWORK AS THE PTS CONTROL CENTER (BY OTHERS)  
 ELECTRICAL CONNECTION (BY OTHERS)  
 SERVICE DISCONNECT FACTORY WIRED (INSIDE UNIT)

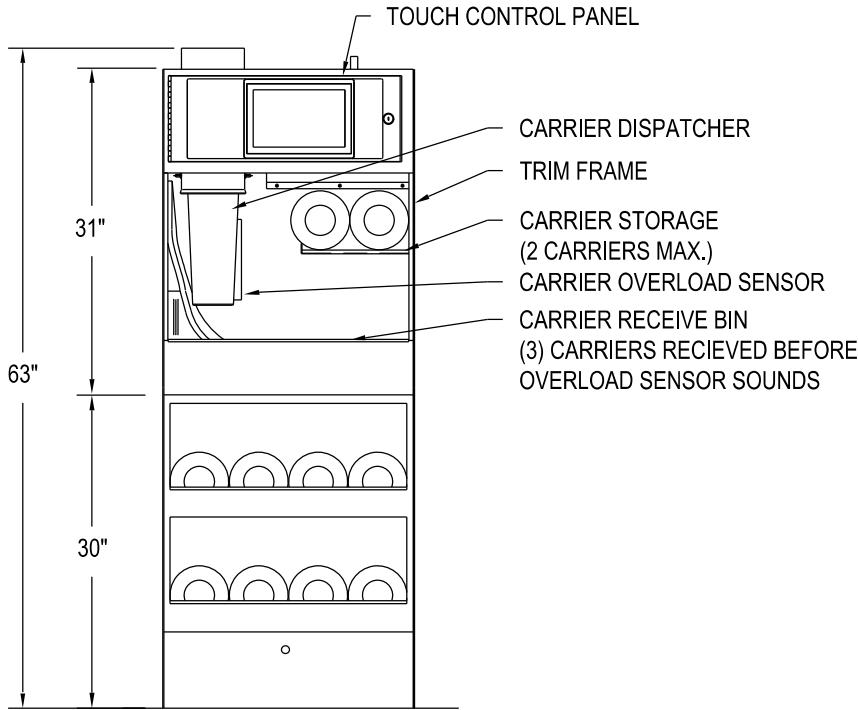

**FRONT VIEW**

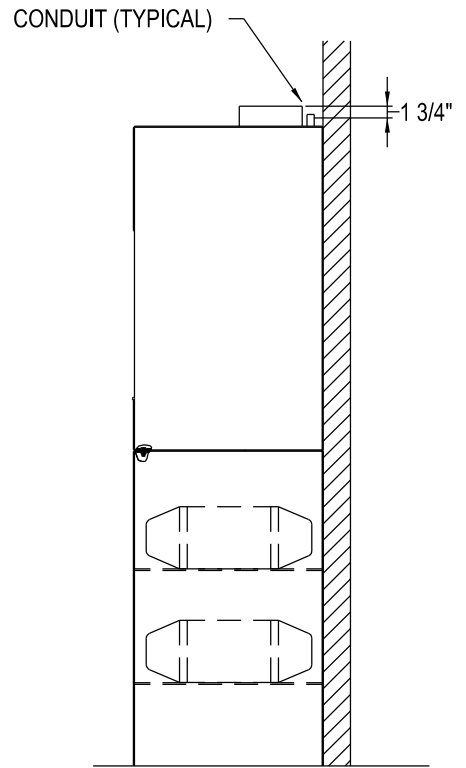

**SIDE VIEW**



1401 Tangier Drive  
 Baltimore, Maryland 21220  
 T 410.931.8800, F 410.931.4660  
 800.296.PEVCO (7382), WWW.PEVCO.COM

**COMPACT STATION WITH CARRIER STORAGE  
 PEDESTAL BASE  
 (ETHERNET COMMUNICATIONS)**

6" COMPUTERIZED PNEUMATIC TUBE SYSTEMS

SCALE	NONE	DATE
DRAWN	S.D.W.	02.24.13
REVISED	A.V.	01.30.25
	-	-
DRAWING NUMBER	PEV200.34A	REVISION 1